




"A"

27; 35

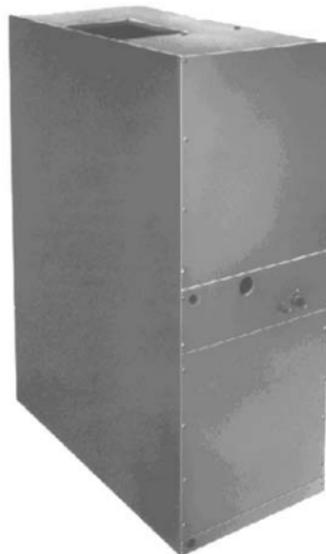

, 2007 .

" "

• :
• A120 , A90 -1 ., A120 - 2 . 17,5
• 35

•
•
•
•
• 60 24 ,

•
•

ARI Standard 210-240

ETL Testing Laboratories, Inc.,

• :
• G-90. ,
• 25,4

•


• :
(90-120)

C


	A90-00-2	A120-00-2	A120-00-5
-	220-1	220-1	380-3
,	198 - 264	198 - 264	342 - 435
,	10,6	14,5	3,3
,	1,1	1,1	1,5
,	305 x 305	305 x 381	279 x 254 - 2
,	139,7	165,1	152
,	19,05	25,4	25,4
,	48,3 73,7	71,1 96,5	86,4 111,8
,	19,05	25,4	22,2
,	1244,6 12,7	1244,6 12,7	1041 12,7
,	15 /	20 /	20 /
,	812,8 x 1193,8 x 25,4	812,8 x 1193,8 x 25,4	406,4 x 508,0 x 50,8 - 2 508,0 x 508,0 x 50,8 - 2
,	0,75	0,93	0,93
(25) -	2-13	4-14	4-14
		- 2	- 2
	R-22	R-22	R-22
	3/8	3/8 - 2	3/8 - 2
,	9/8	9/8 - 2	9/8 - 2
,	3/4	3/4	3/4
	CE090-5A, CKF70-5	CE120-5A, CKF060 x 2 , CPKF060 x 2	CE120-5A, CKF060 x 2 , CPKF060 x 2


	A,	B,	
A90	396,875	415,925	155,3
A120	473,075	373,0625	165,0

90

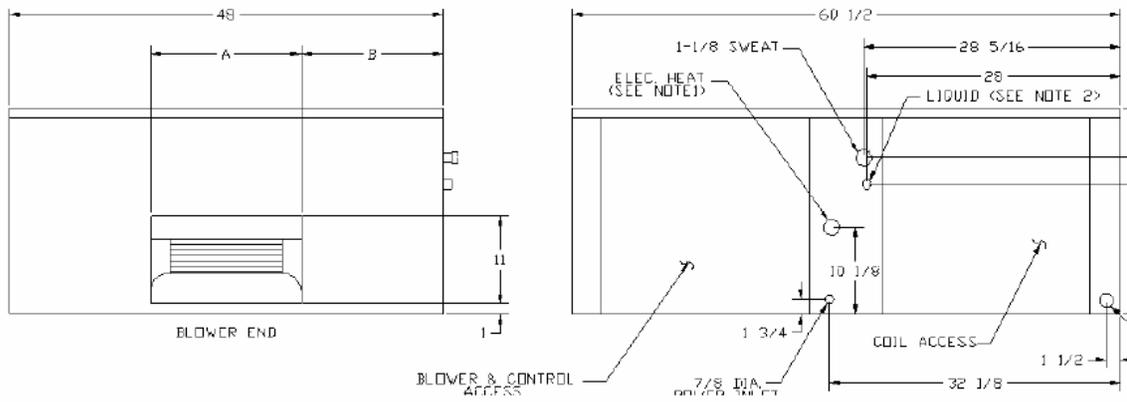

120

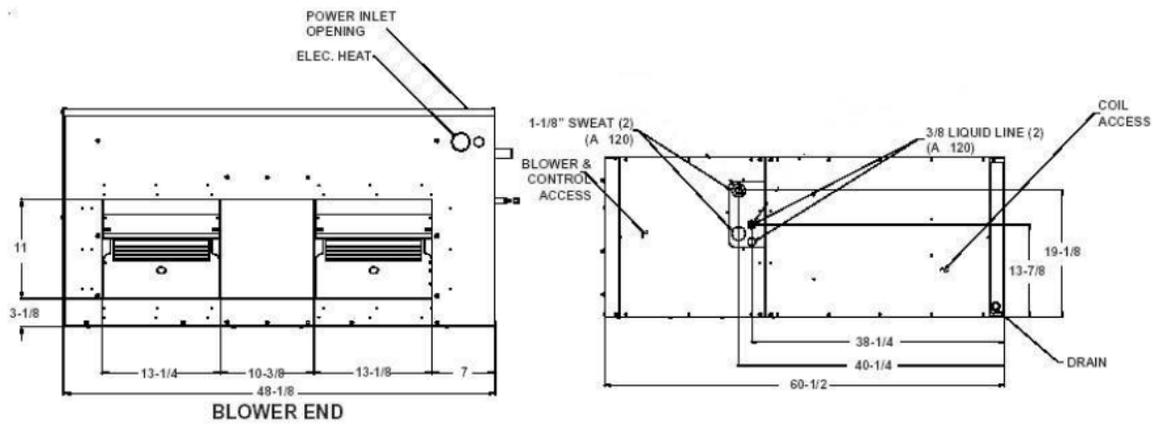

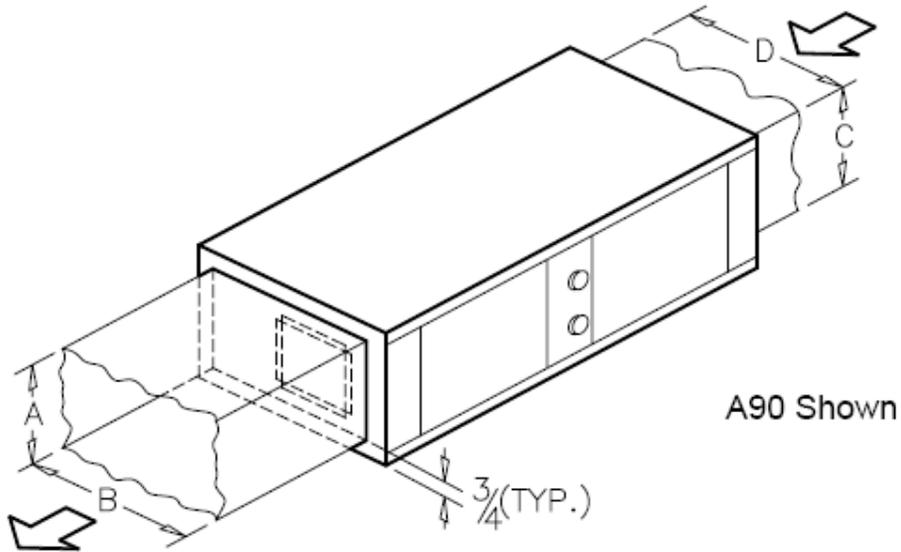

	A	B	C	D
A90/120	292,1	863,6	571,5	1181,1

A90

*

, 3/	,						
	25	50	75	100	125	150	175
	/	/	/	/	/	/	/
4752	--	--	800	830	850	880	945
4932	--	775	795	845	860	898	990
5112	--	800	830	850	880	930	1010
5256	790	830	848	865	895	960	1020
5436	810	840	850	880	930	1000	1030
5616	850	890	880	895	965	1020	1060


A120

*

, 3/	,						
	25	50	75	100	125	150	175
	/	/	/	/	/	/	/
5472	805	830	860	905	920	945	970
5652	830	855	890	920	930	950	980
5796	855	890	910	930	940	955	985
5976	880	905	920	935	950	965	990
6156	905	920	930	945	960	985	1000
6336	915	925	945	955	975	995	1015
6480	930	940	950	960	980	1000	1040
6660	940	950	960	975	990	1025	1120
6840	950	960	970	980	1005	1050	1070
7020	960	965	980	1000	1040	1065	1095
7164	965	985	1005	1020	1045	1080	1130
7344	980	998	1020	1050	1090	1110	1140
7524	1010	1030	1050	1070	1100	1145	1180

*

4%

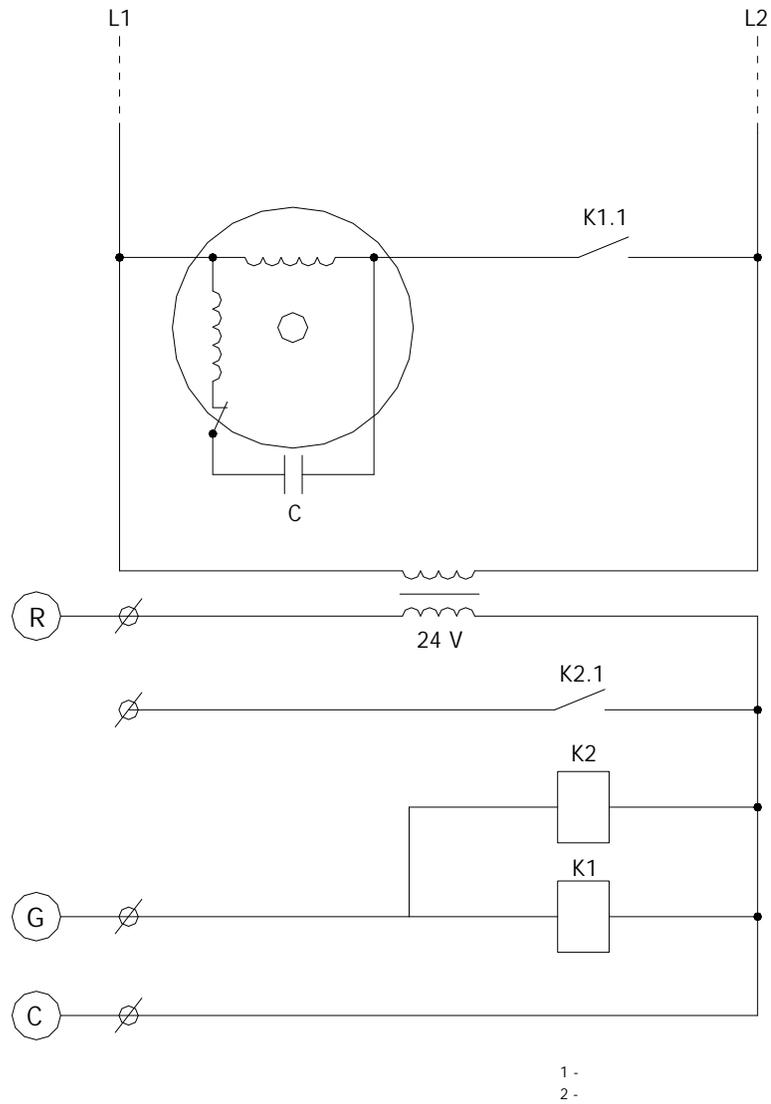

:"

!"

Goodman®

TM , 105318,

, .33

www.mzta.ru www.goodmanrussia.ru/

Copyright C 2007

TM Goodman Manufacturing, L.P. Made in the USA

